



Chilled Water System

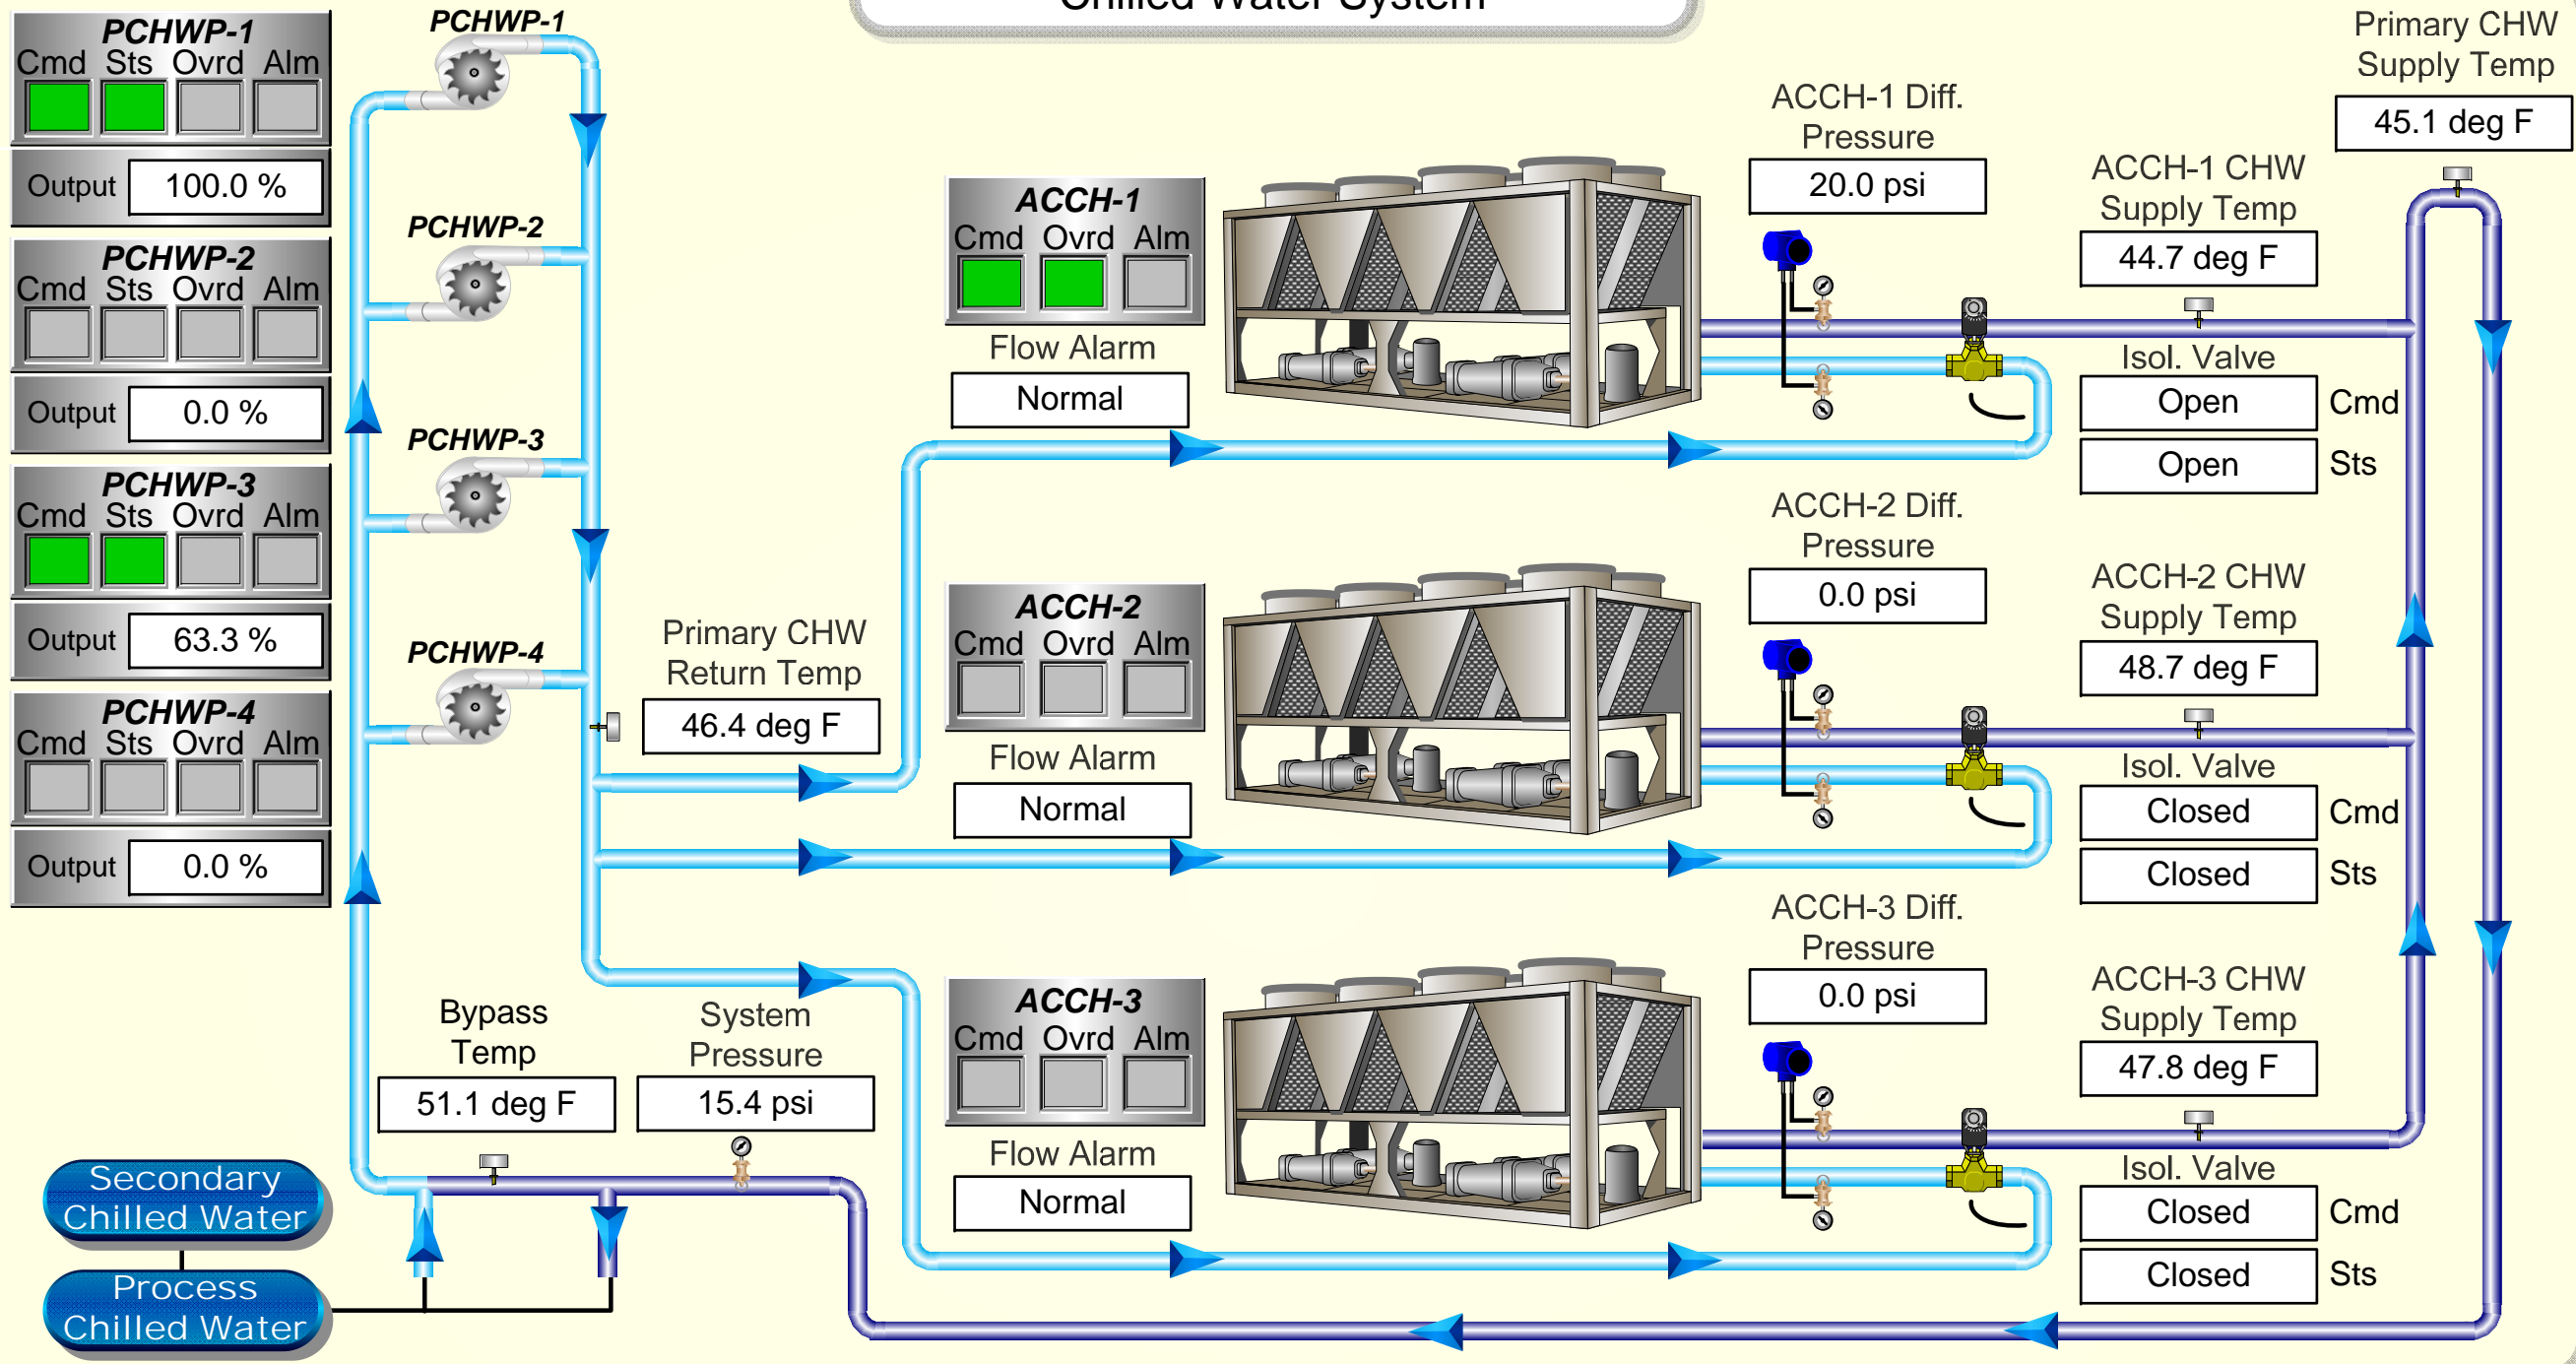

OA Conditions

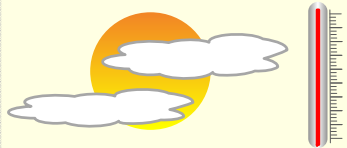

Temp. 75.4 deg F

Humidity 95.0 % RH

CHW System Enable	True
Lead Pump	1
Lag Pump	3
Pump Alarm Reset	Off

ACCH-1 Runtime	1500.6 hrs
ACCH-2 Runtime	1497.8 hrs
ACCH-3 Runtime	1370.4 hrs

CHW Supply Setpoint	43.0 deg F
OA Enable Setpoint	60.0 deg F